


NOTE: 45.00 Gal / Inch

DATE	REV.	LOC.	DESCRIPTION
------	------	------	-------------

- (1) Rebar must be 40,000 psi Strength
 - (2) 6"x6" 6/6 Standard Gauge wire mesh
 - (3) Concrete Strength: 5400 psi @ 28 days
- Effluent Filter
Ansi/NSF Standard 46

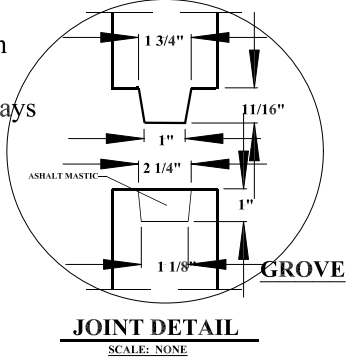

5000 GALLON DOUBLE COMPARTMENT SEPTIC TANK

COATE CONCRETE PRODUCTS	
P. O. BOX 159, WEST MILTON, OH 45383	
WEST MILTON PHONE: (937) 698-4181	
OHIO WATS PHONE: (800) 762-4066	
MODEL: 5000 GALLON SEPTIC TANK	
MATERIAL: VIBRATED CONCRETE REINFORCED W/ 6X6" 6/6 WIRE MESH & #4 (1/2") REBAR	
SCALE: 3/8" = 1'-0" UNLESS OTHERWISE NOTED	
DR. BY: RVA	DATE: 04/25/17
DWG. No: 01-5000DC-A01	SHEET 1 OF 1